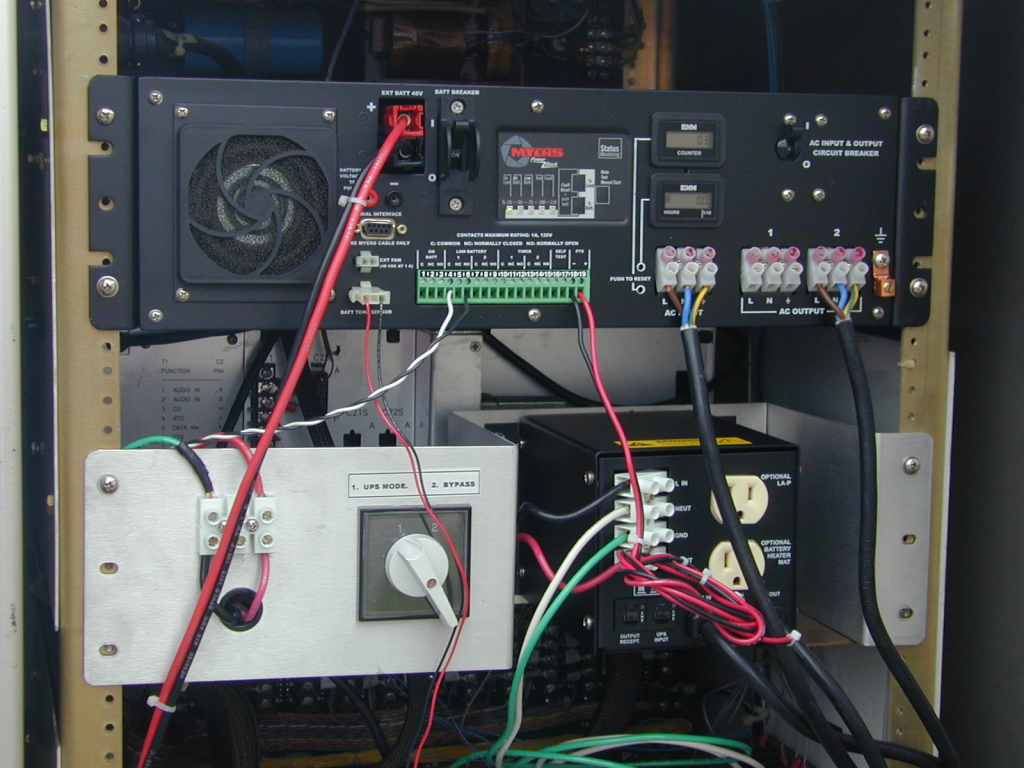
EXT BATT 48V
BATT BREAKER
MYERS
Status
COUNTER
HOURS
AC INPUT & OUTPUT
CIRCUIT BREAKER
CONTACTS MAXIMUM RATING: 1A, 120V
C: COMMON NO: NORMALLY CLOSED NO: NORMALLY OPEN
PUSH TO RESET
AC OUTPUT
1. UPS MODE
2. BYPASS
OPTIONAL L.A.P
OPTIONAL BATTERY HEATER MAT
OUTPUT RECEPT
UPS INPUT