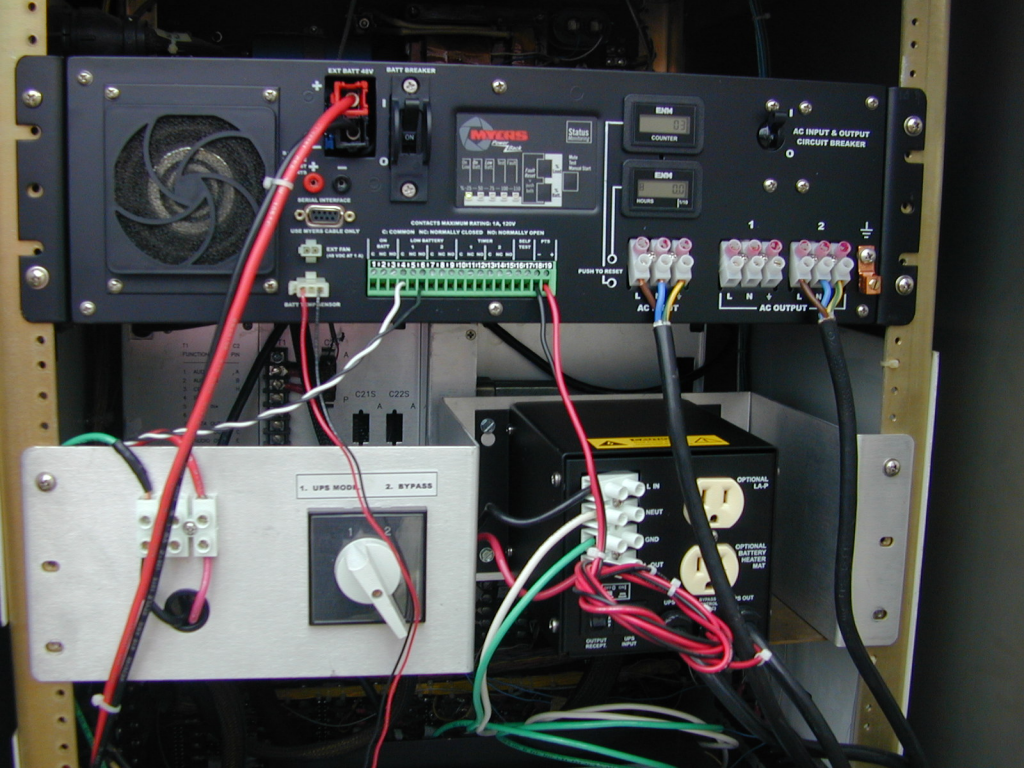
EXT BATT 48V
BATT BREAKER
ON
MYERS
Status
SERIAL INTERFACE
USE MYERS CABLE ONLY
EXT FAN
CONTACTS MAXIMUM RATING: 1A, 120V
C: COMMON NC: NORMALLY CLOSED NO: NORMALLY OPEN
COUNTER
HOURS
PUSH TO RESET
AC INPUT & OUTPUT CIRCUIT BREAKER
AC OUTPUT
C21S
C22S
1. UPS MODE
2. BYPASS
OPTIONAL LAP
OPTIONAL BATTERY HEATER MAT
OUTPUT RECEPT.
UPS INPUT